


Shaw Campus – Air Conditioning Chilled Water Pipe Replacement Works to
David C. Lam Building
逸夫校園－思齊樓空調冷凍水喉更換工程

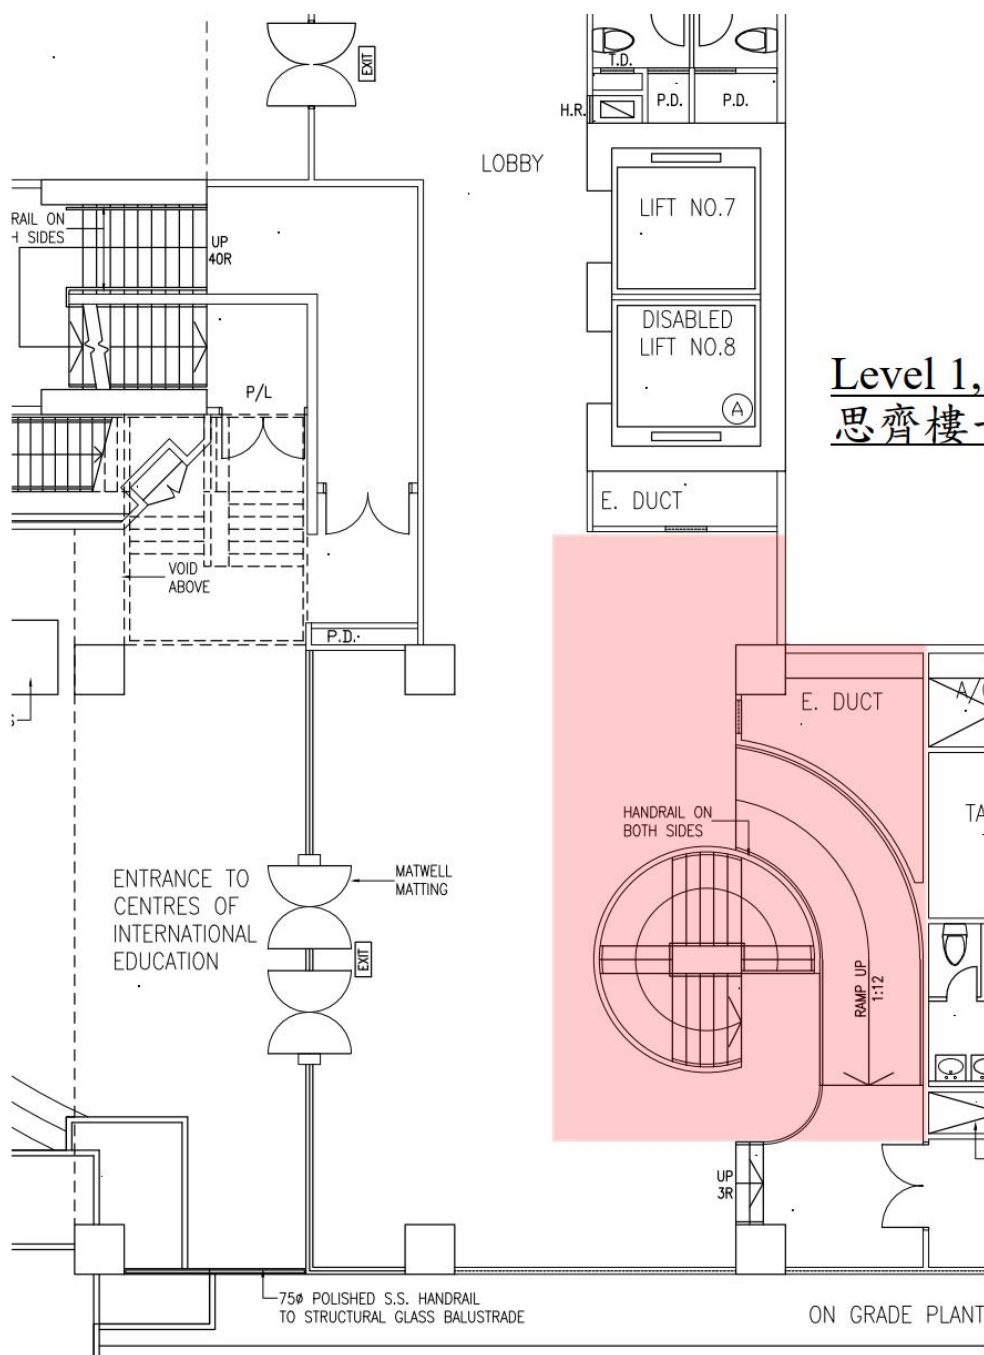

Level 1, David C. Lam Building
思齊樓一樓大堂

Affected Area
受影響範圍